


UNITAIRE IV FAN COIL UNITS

CRBR & CRBB

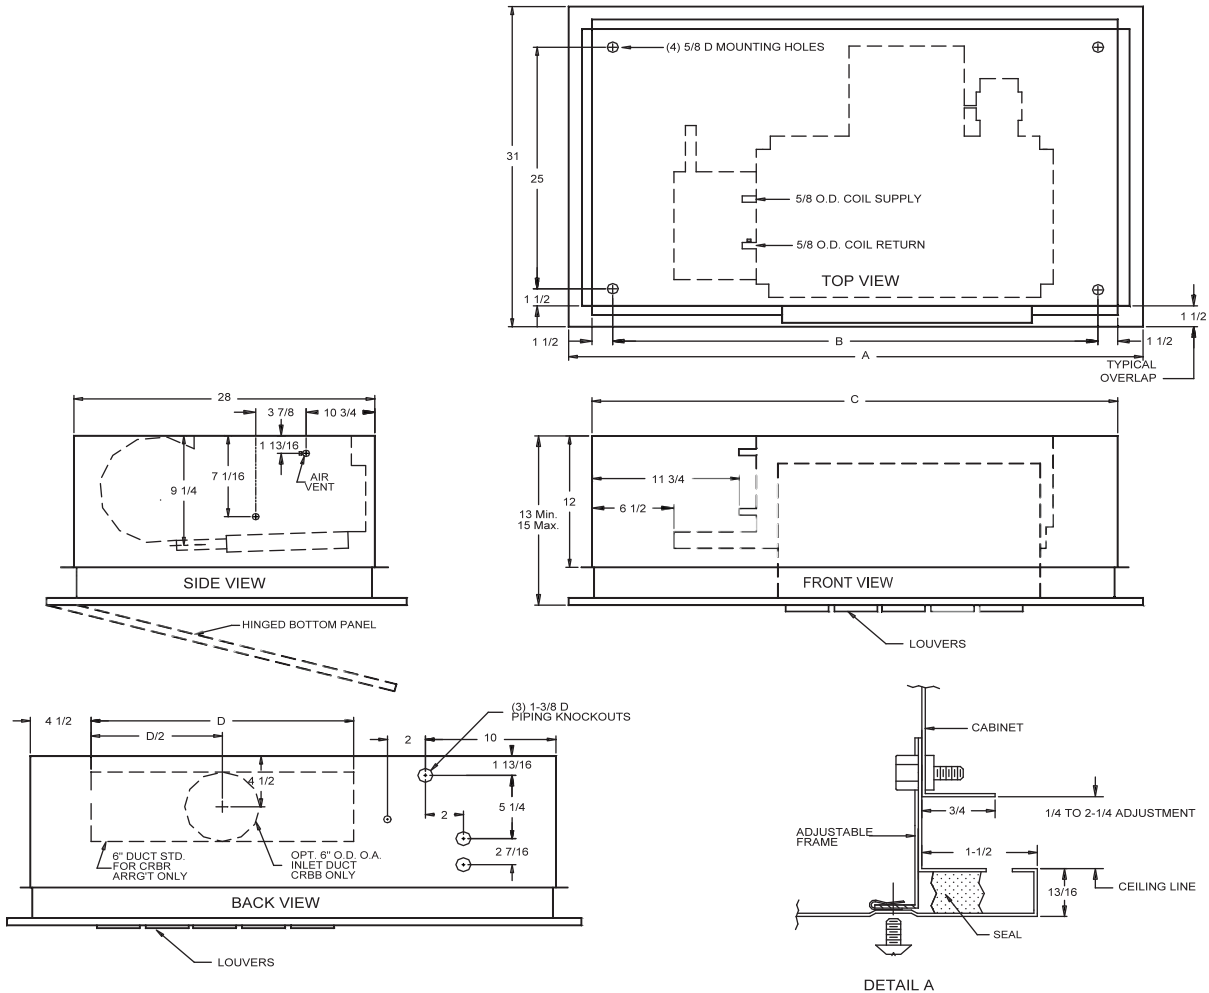


LEFT HAND PIPING CONNECTIONS SHOWN. RIGHT HAND OPPOSITE. PIPING HAND DETERMINED WHEN FACING AIR OUTLET.
 STANDARD LOCATION OF THE ELECTRICAL JUNCTION BOX IS ON THE SAME SIDE AS THE PIPING.
 FIELD ADJUSTMENT OF INTERNAL PLENUM WILL BE REQUIRED AFTER HANGING UNIT.
 ELECTRIC HEAT IS NOT AVAILABLE.


DIMENSIONS				
UNIT SIZE	A*	B	D	E
02	42	36	39	20
03	48	42	45	26
04	52	46	49	30
06	66	60	63	44
08	78	72	75	56
01/12	98	92	95	76

* = When units are furnished with DDC controls, add 4" to "A" dimension.

OPTIONAL 1-ROW AUXILIARY HEATING COIL

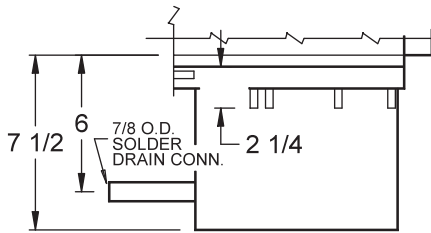

TOP VIEW

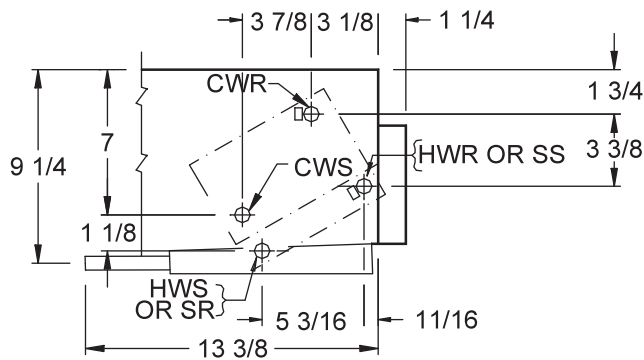

LEGEND

CWS-CWR: Chilled Water Supply – Return

HWS-HWR: Hot Water Supply - Return

SS-SR: Steam Supply – Return

SPECIAL NOTES

1-Row Auxiliary Water Coil Connections may be “Same As” or “Opposite” Cooling Coil Piping.

Contact factory if opposite end connections are required.

1-Row Auxiliary Steam Coil contact factory.

CONTROL PACKAGES

Control Packages require Engineering Investigation for confirmation of adequate space allowance.

Coil connections are 5/8” O.D. sweat

